

AIRTECH[®]

VACUUM

MEDICAL VACUUM SYSTEMS

NFPA 99C Compliant Medical Vacuum Systems Base-Mounted Oil Flooded Rotary Vane

Airtech NFPA compliant Medical Vacuum Systems are manufactured and tested to *NFPA 99C standards. Each of our various medical systems utilize only the highest quality components and each system is provided with the following features:

- UL Listed NEMA 12 enclosed motor control center
 - UL listed through the door disconnect switches (5.1.3.6.6.3)*
 - Individual control transformers (5.1.3.6.6.3)*
 - Vacuum receiver by-pass assembly (5.1.3.6.5.2)*
 - ASME coded vacuum receiver (5.1.3.6.3)*
 - Lag alarm-audible alarm and indicator light (5.1.9.4.4)*
 - Dry contacts for remote monitoring to master alarm
- Optional: Motor control center with Ethernet/BMS capabilities-Consult Factory!






TRIPLEX BASE MOUNTED
ROTARY VANE VACUUM PACKAGE

NFPA 99C Compliant Medical Vacuum Systems

Triplex Stacked Base-Mounted Rotary Vane Vacuum Package

NO.	QUAN.	DESCRIPTION
1	3	VACUUM PUMP
2	3	ELECTRIC MOTOR
3	1	TANK
4	1	CONTROL PANEL
5	1	STEEL BASE

Note: Specifications are subject to change without notice. Please contact factory for specification updates.

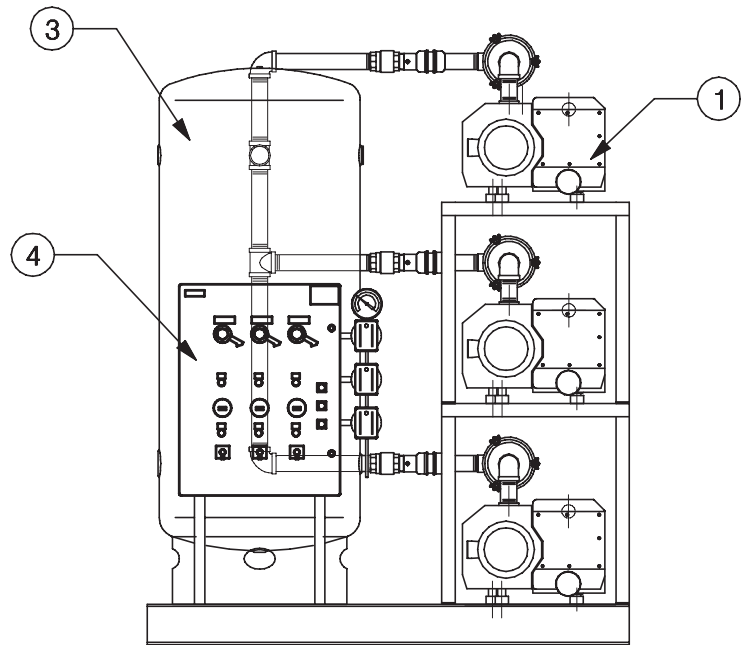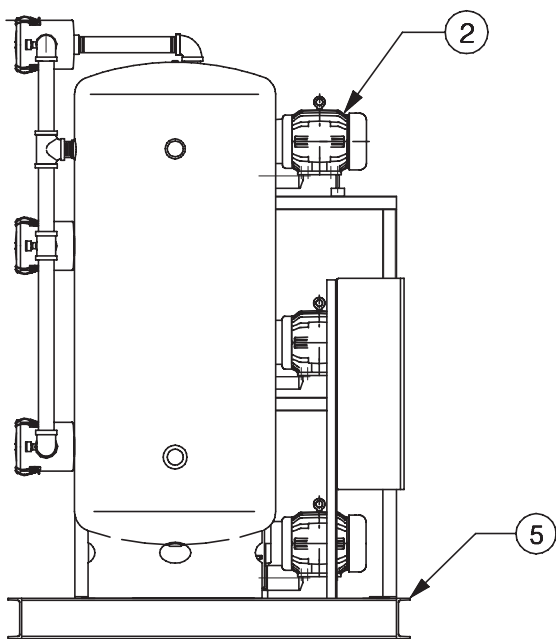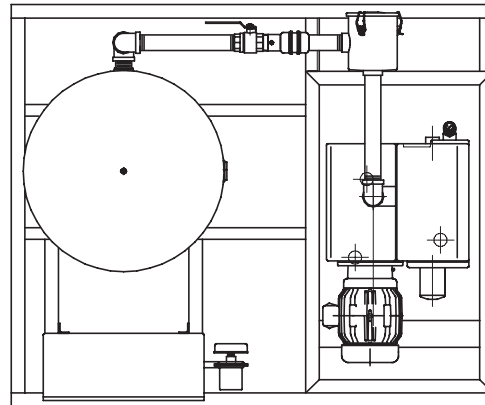

Note: Simplex, Duplex, Triplex Systems are standard.
See individual drawings for Dimensions

AIRTECH

301 Veterans Blvd.
Rutherford, NJ 07070
Tel: (888) 222-9940
Fax: (201) 569-1696
airtech@airtechusa.com

AIRTECH SOUTH

2121 Newmarket Pkwy. Suite 110
Marietta, GA 30067
Tel: (770) 690-0700
Fax: (770) 690-0709
airtechsouth@airtechusa.com

AIRTECH WEST

42 Digital Drive, Suite 9
Novato, CA 94949
Tel: (415) 382-9000
Fax: (415) 382-9700
airtechwest@airtechusa.com